




ACOUSTIC ABSORPTION MEASUREMENT PROTOCOL (ISO 354, ISO 11654)


Specifications

Manufacturer	Création Baumann - Weberei und Färberei AG - CH-4901 Langenthal	
Product name	CALVARO 100% PLF Trevira CS	
Remarks, configuration	Decoration fabric Measurement configuration: Curtain draped by 100%, average distance to the wall d = 15 cm	
Set-up (acc. ISO 354/2nd Ed.:2003)	Type G-150	No. of measurements 3 each microphone
Probe area	3.00 x 4.20 = 12.60 m ²	No. of used microphone 9
Temperature	23.8 °C	Used acoustic Signal White noise
Relative Humidity	40.4 % r.H.	Empty room measurement Interpolated values
Volume of the reverberation chamber	214.3 m ³	EEC Order No. 13080
Measurement No. / Date / Time	Nr. 06 / 23.10.2012 / 10h51'	Archive filename CRBA1225
Tested by	Martin Lengacher	

EUT identification

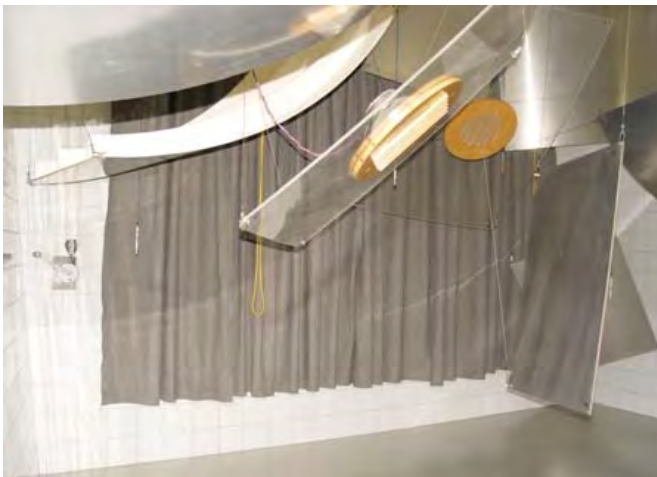


Test set-up

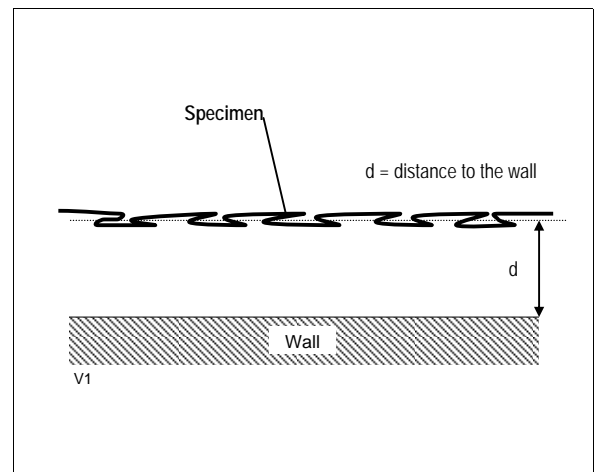

Measurement results (acc. ISO 354, ISO 11654)

Freq. [Hz]	T ₁	T ₂	α _s	α _{pi}	α _w
100	20.36	12.23	0.09		0.15
125	17.38	9.13	0.14		
160	15.54	6.41	0.25		0.45
200	11.29	4.92	0.31		
250	10.86	3.99	0.43		0.75
315	9.39	3.02	0.61		
400	7.98	2.58	0.71		0.80
500	8.41	2.50	0.77		
630	8.03	2.56	0.72		0.90
800	7.67	2.46	0.75		
1'000	7.06	2.35	0.77		0.95
1'250	6.01	2.10	0.84		
1'600	5.39	1.95	0.89		0.95
2'000	4.69	1.88	0.87		
2'500	4.14	1.74	0.91		0.95
3'150	3.55	1.63	0.90		
4'000	2.90	1.42	0.98		0.95
5'000	2.31	1.26	0.98		

0.75 (H) Class "C"

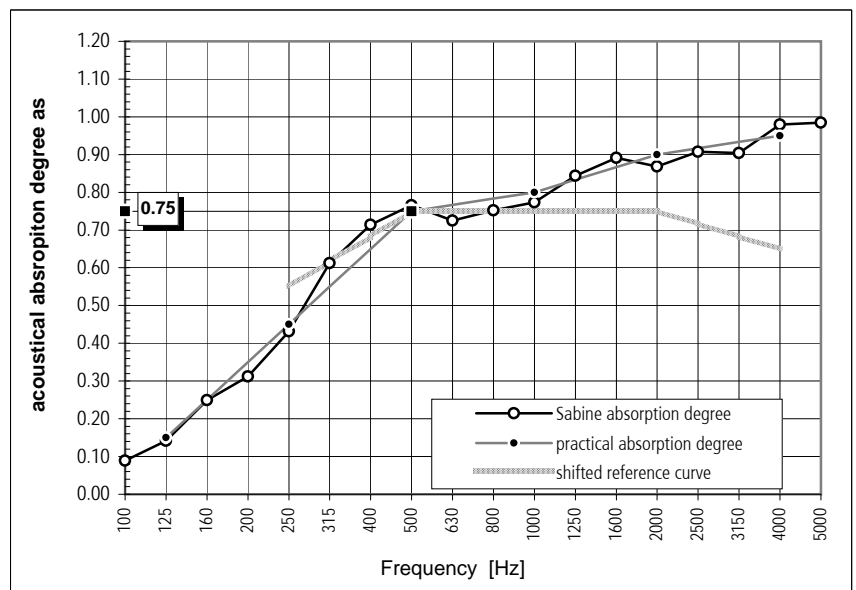

Error: 100 - 315 Hz : 3.78% 400 - 1250 Hz : 2.25% 1600 - 5000 Hz : 1.51%

LEGEND	α _s = Sabine absorption degree
T ₁ = Reverberation time of the empty room	α _{pi} = practical absorption degree
T ₂ = Reverberation time with the test specimen	α _w = assessed absorption degree



ACOUSTIC ABSORPTION MEASUREMENT PROTOCOL (ISO 354, ISO 11654)


Specifications

Manufacturer	Création Baumann - Weberei und Färberei AG - CH-4901 Langenthal	No. of measurements	3 each microphone
Product name	CALVARO 100% PLF Trevira CS	No. of used microphone	9
Remarks, configuration	Decoration fabric Measurement configuration: Curtain panels, average distance to the wall d = 15 cm	Used acoustic Signal	White noise
Set-up (acc. ISO 354/2nd Ed.:2003)	Type G-150	Empty room measurement	Interpolated values
Probe area	3.00 x 4.20 = 12.60 m ²	EEC Order No.	13080
Temperature	23.8 °C	Archive filename	CRBA1224
Relative Humidity	40.4 % r.H.		
Volume of the reverberation chamber	214.3 m ³		
Measurement No. / Date / Time	Nr. 05 / 23.10.2012 / 10h23'		
Tested by	Martin Lengacher		

EUT identification




Test set-up

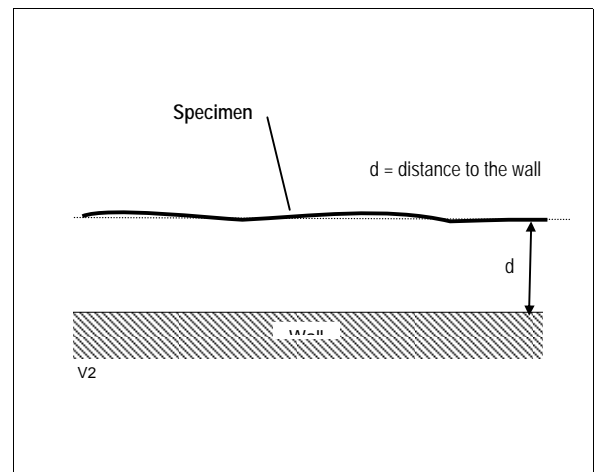

Measurement results (acc. ISO 354, ISO 11654)

Freq. [Hz]	T ₁	T ₂	α _s	α _{pi}	α _w
100	20.35	17.27	0.02	0.05	0.60 (H) Class "C"
125	17.39	12.54	0.06		
160	15.54	9.34	0.12		
200	11.28	6.70	0.17	0.30	
250	10.86	5.02	0.29		
315	9.39	3.98	0.39		
400	7.98	3.12	0.53	0.60	
500	8.40	2.84	0.63		
630	8.04	2.69	0.67		
800	7.67	2.58	0.70	0.65	
1'000	7.06	2.68	0.63		
1'250	6.01	2.61	0.59		
1'600	5.38	2.43	0.62	0.65	
2'000	4.69	2.21	0.65		
2'500	4.13	2.08	0.65		
3'150	3.55	1.86	0.70	0.75	
4'000	2.89	1.61	0.75		
5'000	2.31	1.37	0.81		

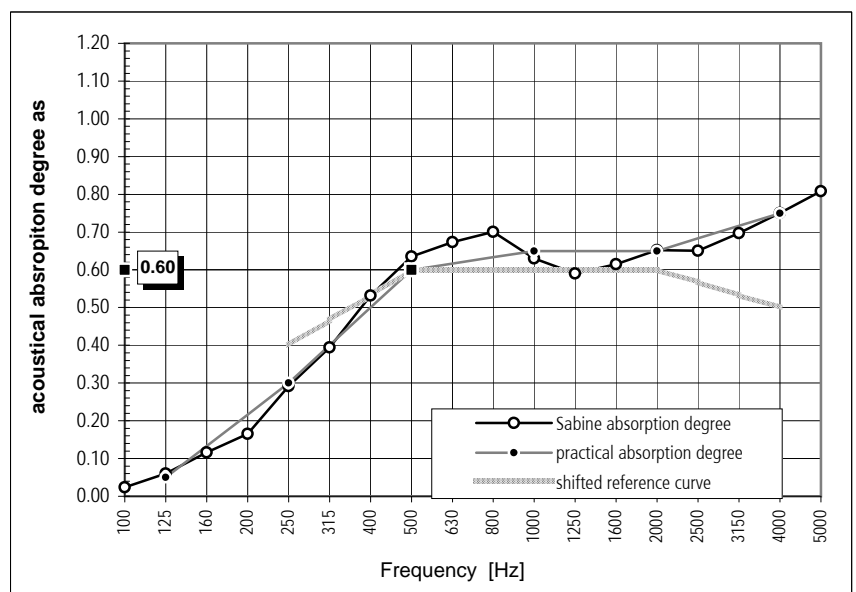

Error: 100 - 315 Hz : 9.54% 400 - 1250 Hz : 2.30% 1600 - 5000 Hz : 1.60%

LEGEND

- T₁ = Reverberation time of the empty room
- T₂ = Reverberation time with the test specimen
- α_s = Sabine absorption degree
- α_{pi} = practical absorption degree
- α_w = assessed absorption degree